

February 24, 2021

Addendum 2


Morehead City Country Club
Clubhouse
Morehead City, NC

The following addendum shall supersede previous information and does hereby become part of the contract documents.

- See attached BD-6, BD-6.1, BD-6.2, BD-6.3, and BD-6.4 for interior stair concept. Final details will be reviewed with Shop Drawings from Steel Stair Manufacturer.
- See attached SK1.0 and SK1.1 for revisions to structure to accommodate interior stair support.
- See attached BD-9 and BD-9.1 for sliding pocket wall added in Member Dining 204.
Please note in BD-9.1 relocated lights and HVAC registers/returns. Please accommodate with revised/extended duct work as required.

End of Addendum 2

**MOREHEAD CITY COUNTRY CLUB
CLUBHOUSE**
MOREHEAD CITY, NORTH CAROLINA

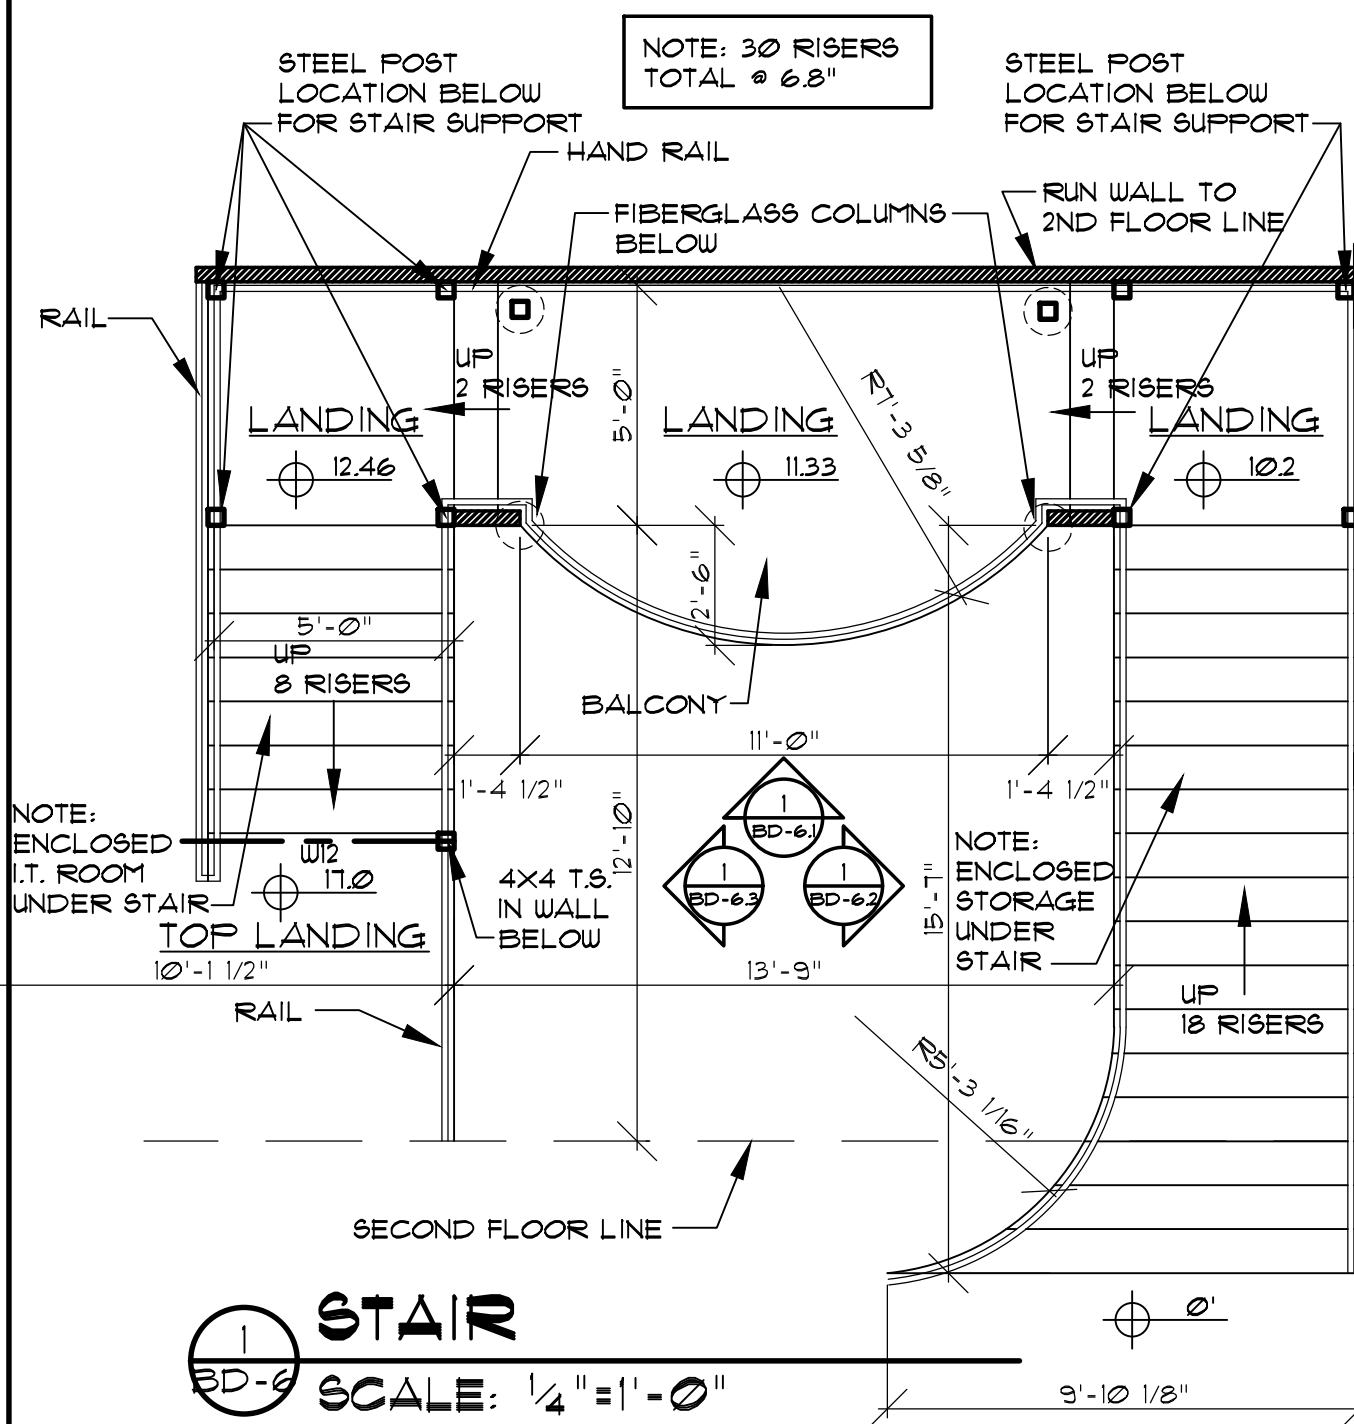

ADDENDUM 2

20010

ISSUED: 02/24/21

DWG BY: MES

CKD BY: LDD

REVISIONS

--	--	--

--	--	--

--	--

--	--

--	--	--

4 SHE


LD

IBL

OF

**MOREHEAD CITY COUNTRY CLUB
CLUBHOUSE**
MOREHEAD CITY, NORTH CAROLINA

NOTE: DECORATIVE METAL RAILS,
PICKETS, ETC. TO BE SELECTED BY
OWNER/ARCHITECT

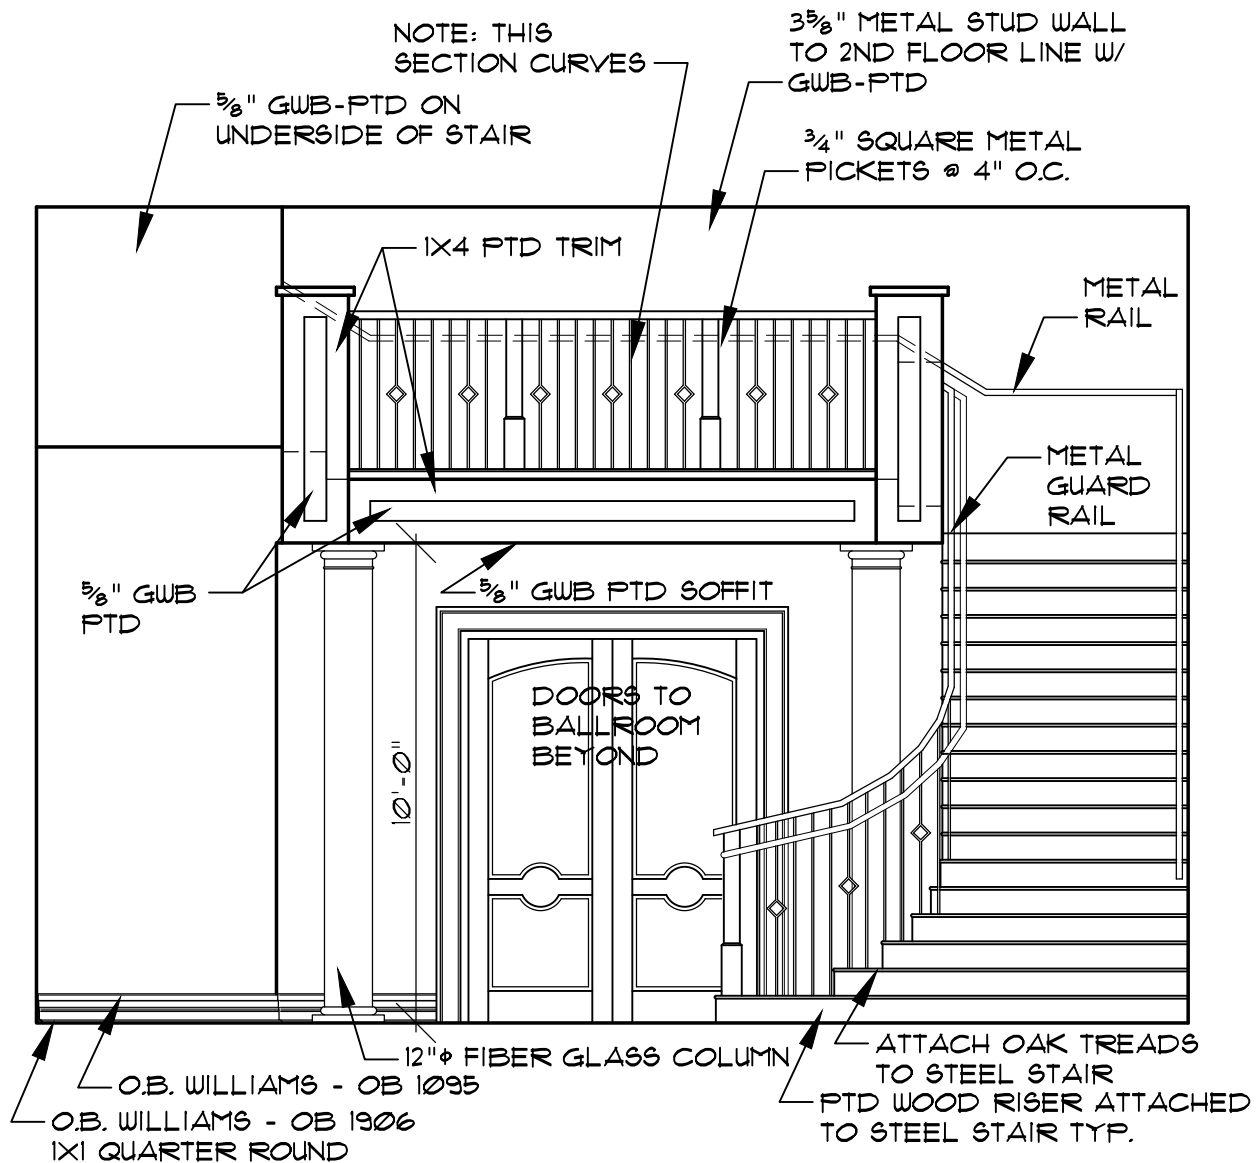

STAIR ELEVATION

SCALE: 1/4" = 1'-0"

ADDENDUM 2

20010

ISSUED: 02/24/21

DWG BY: MES

CKD BY: LDD


REVISIONS

SHEET NO.

BD-6.1

OF 1

**MOREHEAD CITY COUNTRY CLUB
CLUBHOUSE**
MOREHEAD CITY, NORTH CAROLINA

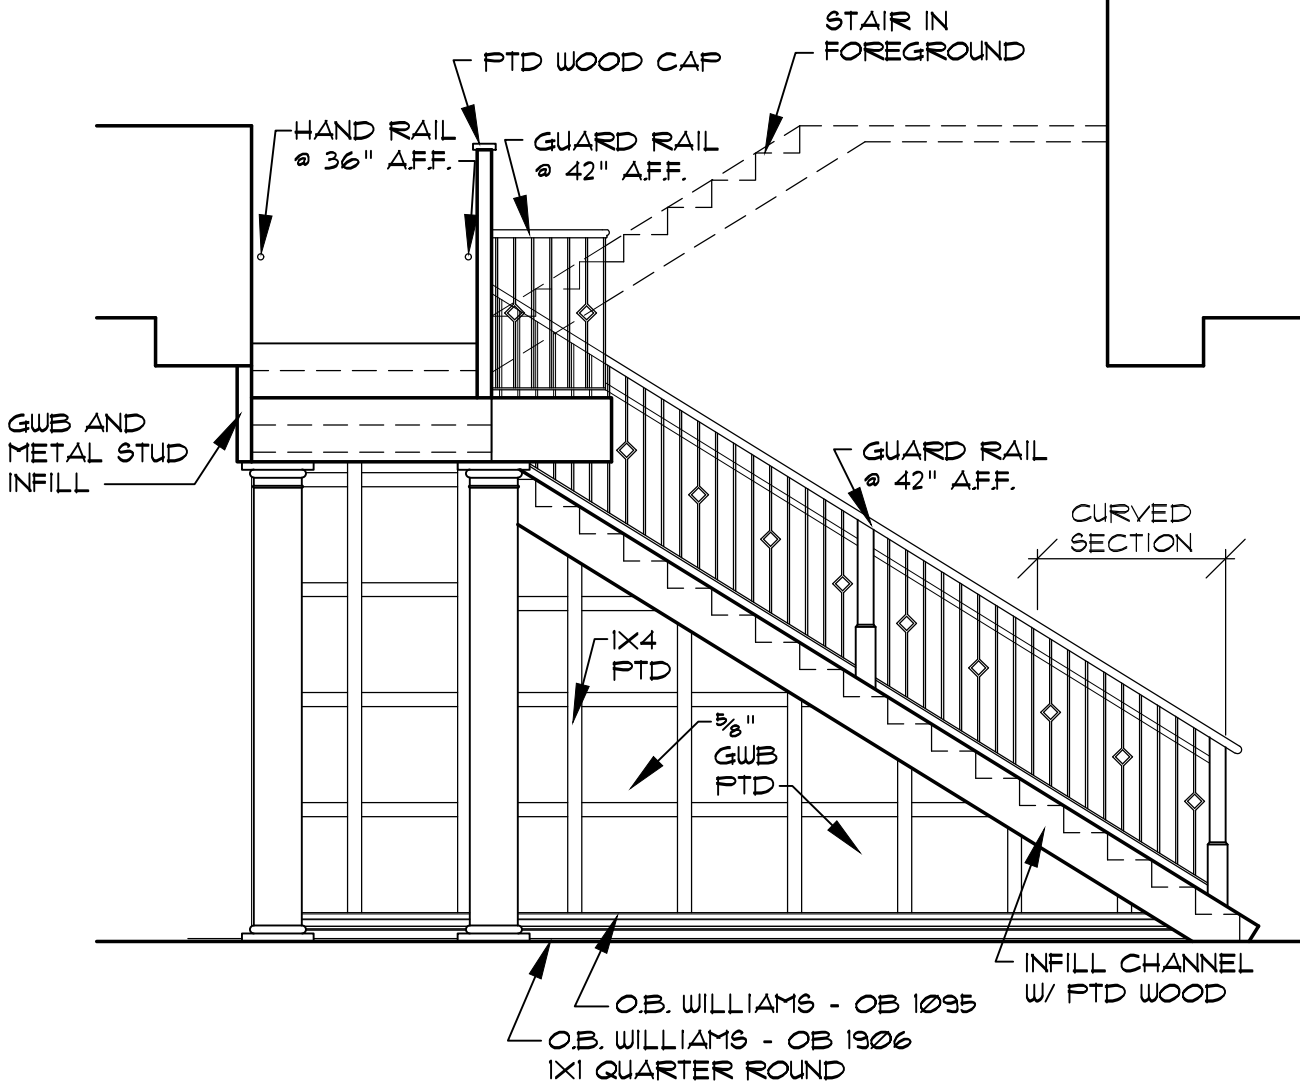

STAIR ELEVATION

SCALE: 1/4" = 1'-0"

ADDENDUM 2

20010

ISSUED: 02/24/21

DWG BY: MES

CKD BY: LDD

REVISIONS

SHEET NO.

BD-6.2

OF 1

**MOREHEAD CITY COUNTRY CLUB
CLUBHOUSE**
MOREHEAD CITY, NORTH CAROLINA

ADDENDUM 2

20010

ISSUED: 02/24/21


DWG BY: MES

CKD BY: LDD

REVISIONS



SHEET NO.

BD-6.3
OF 1

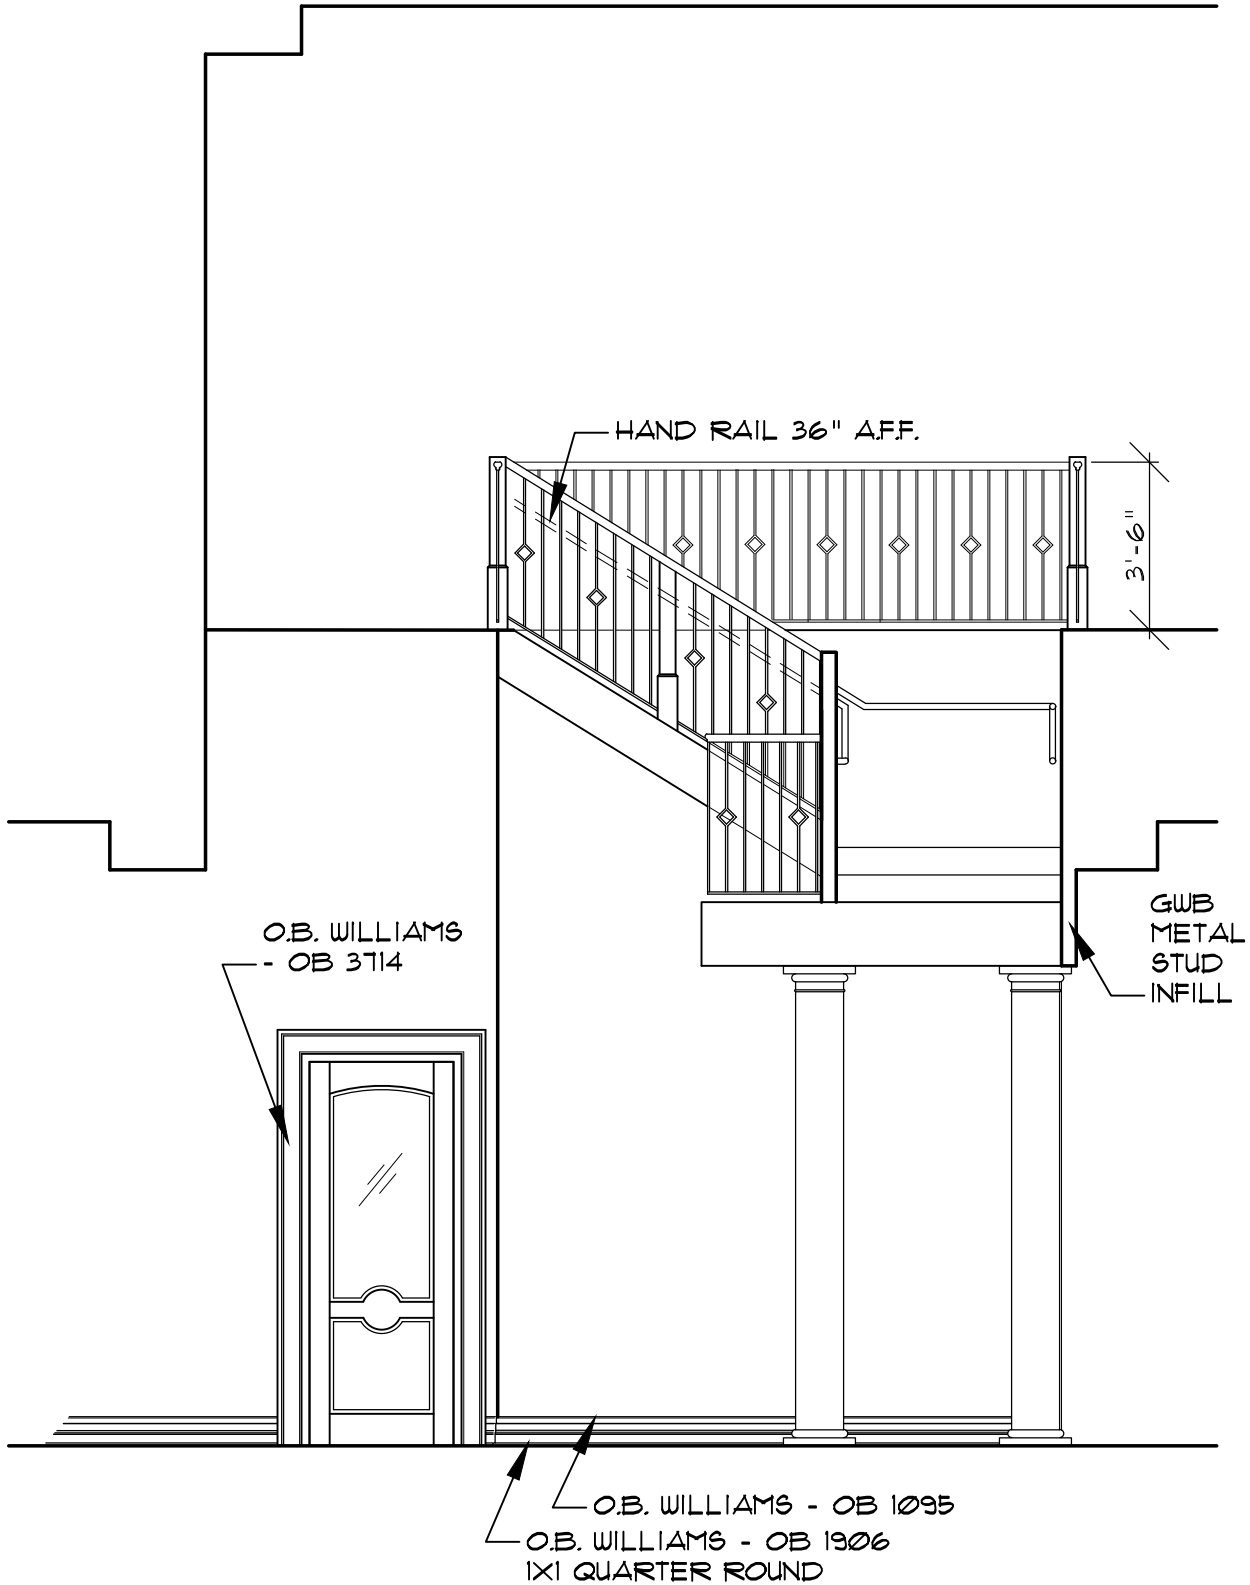


STAIR ELEVATION


SCALE: 1/4" = 1'-0"

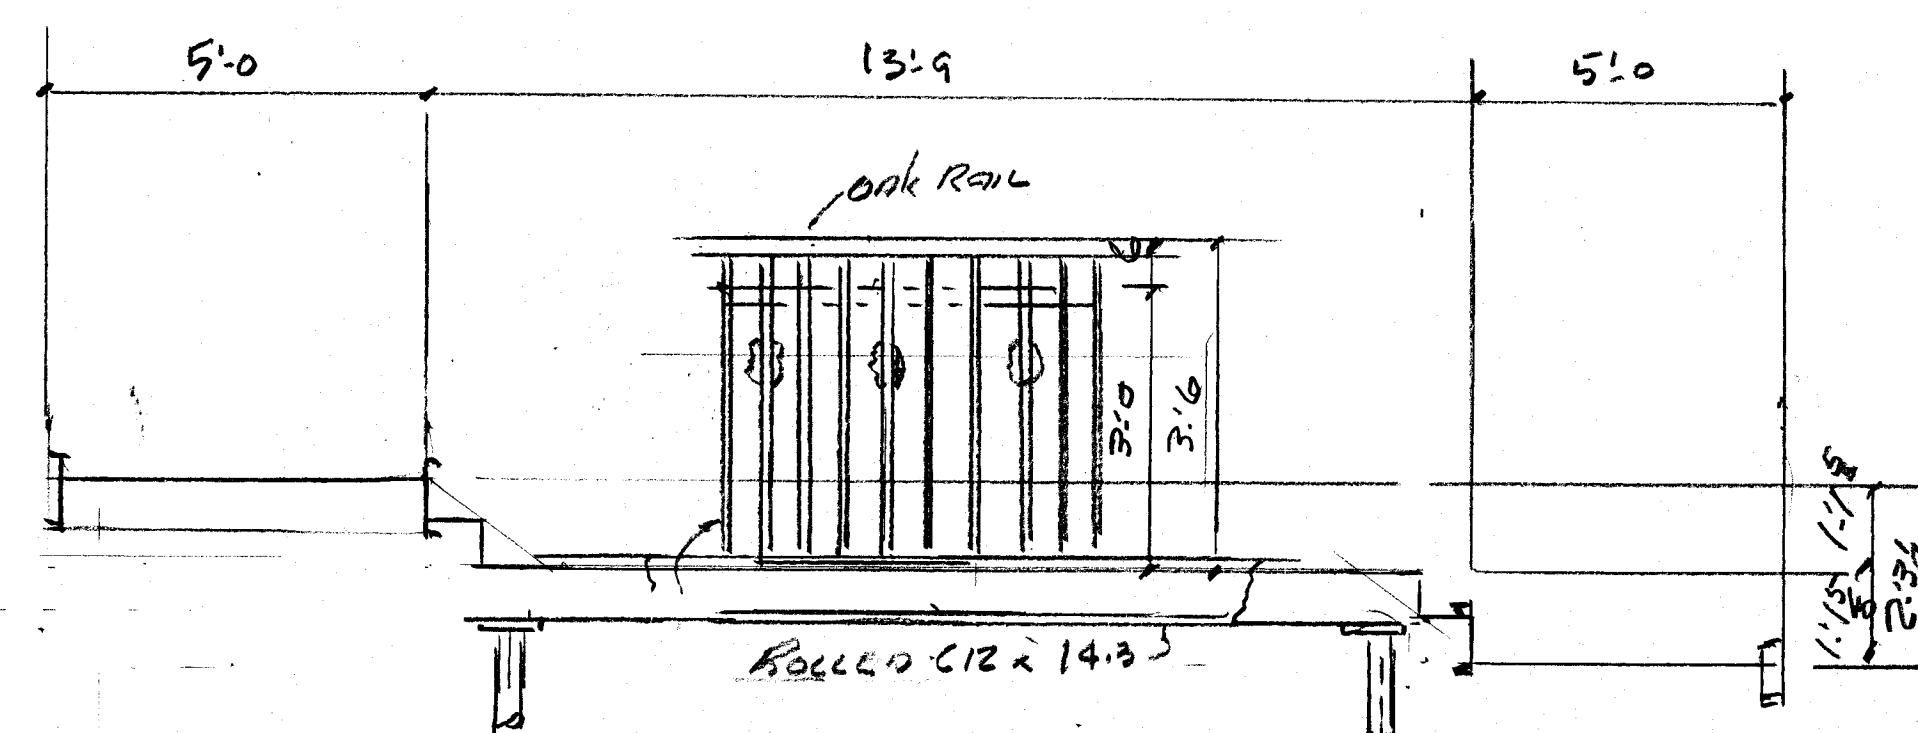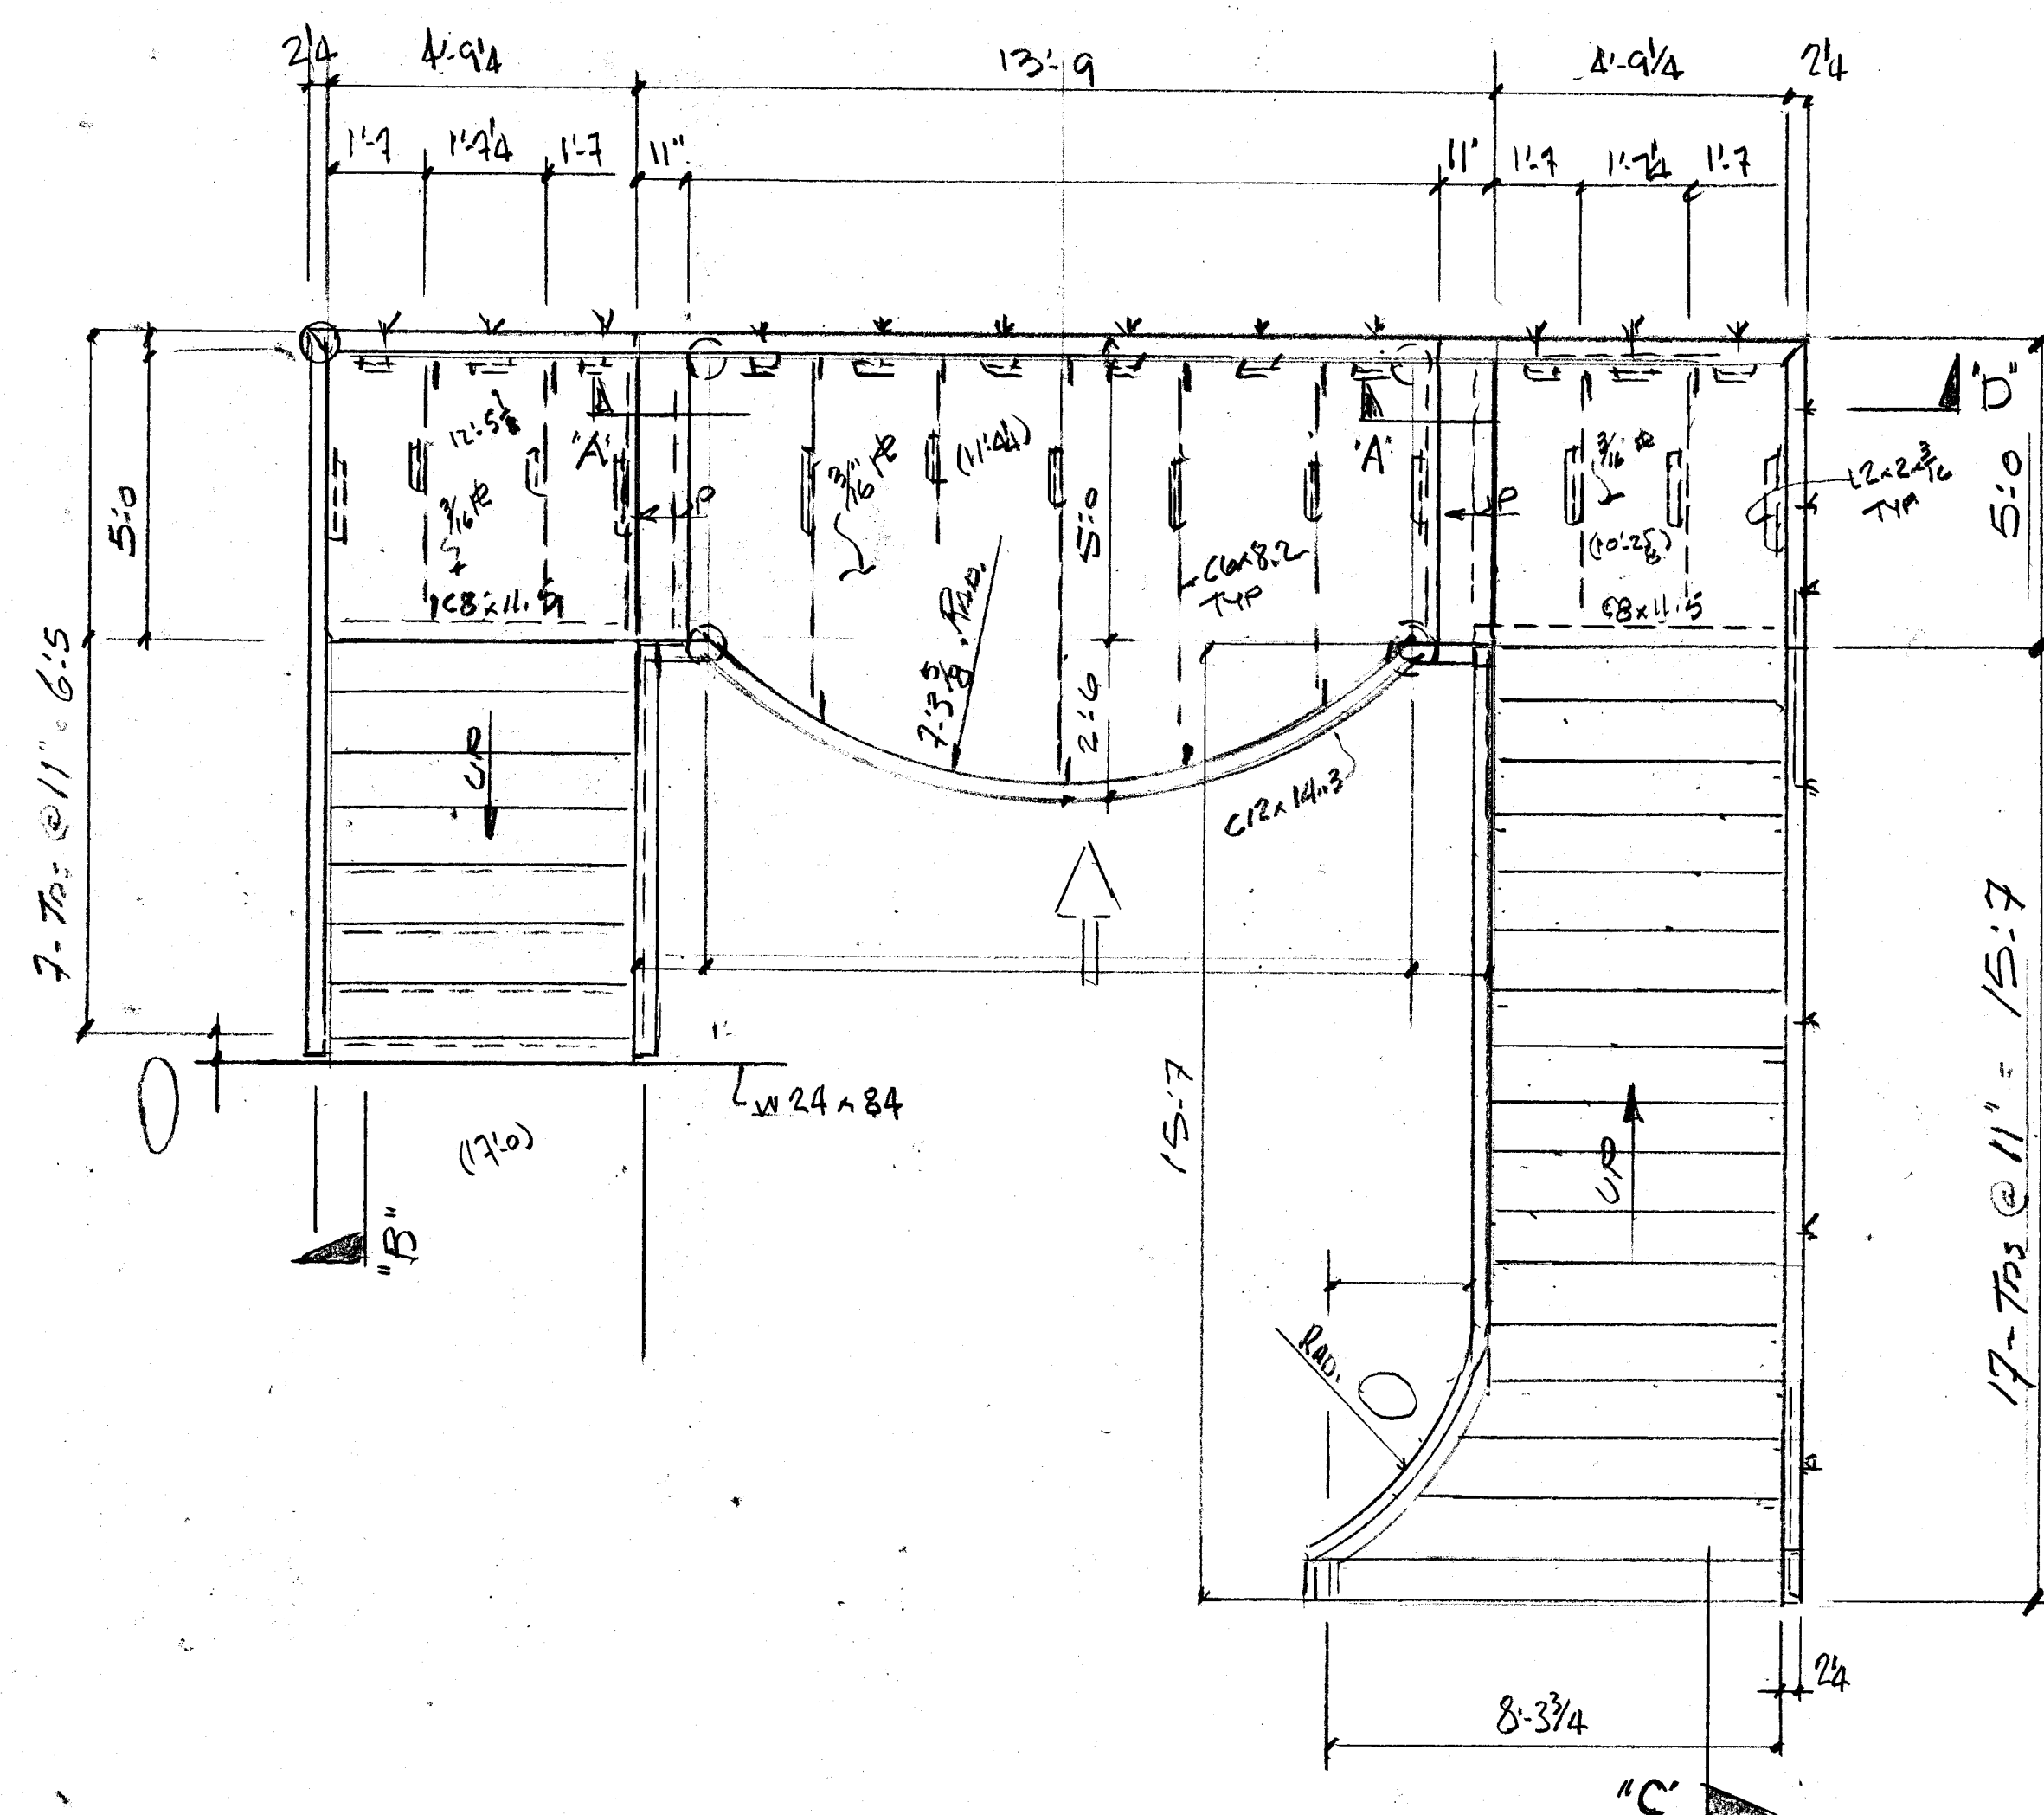


FRONT VIEW

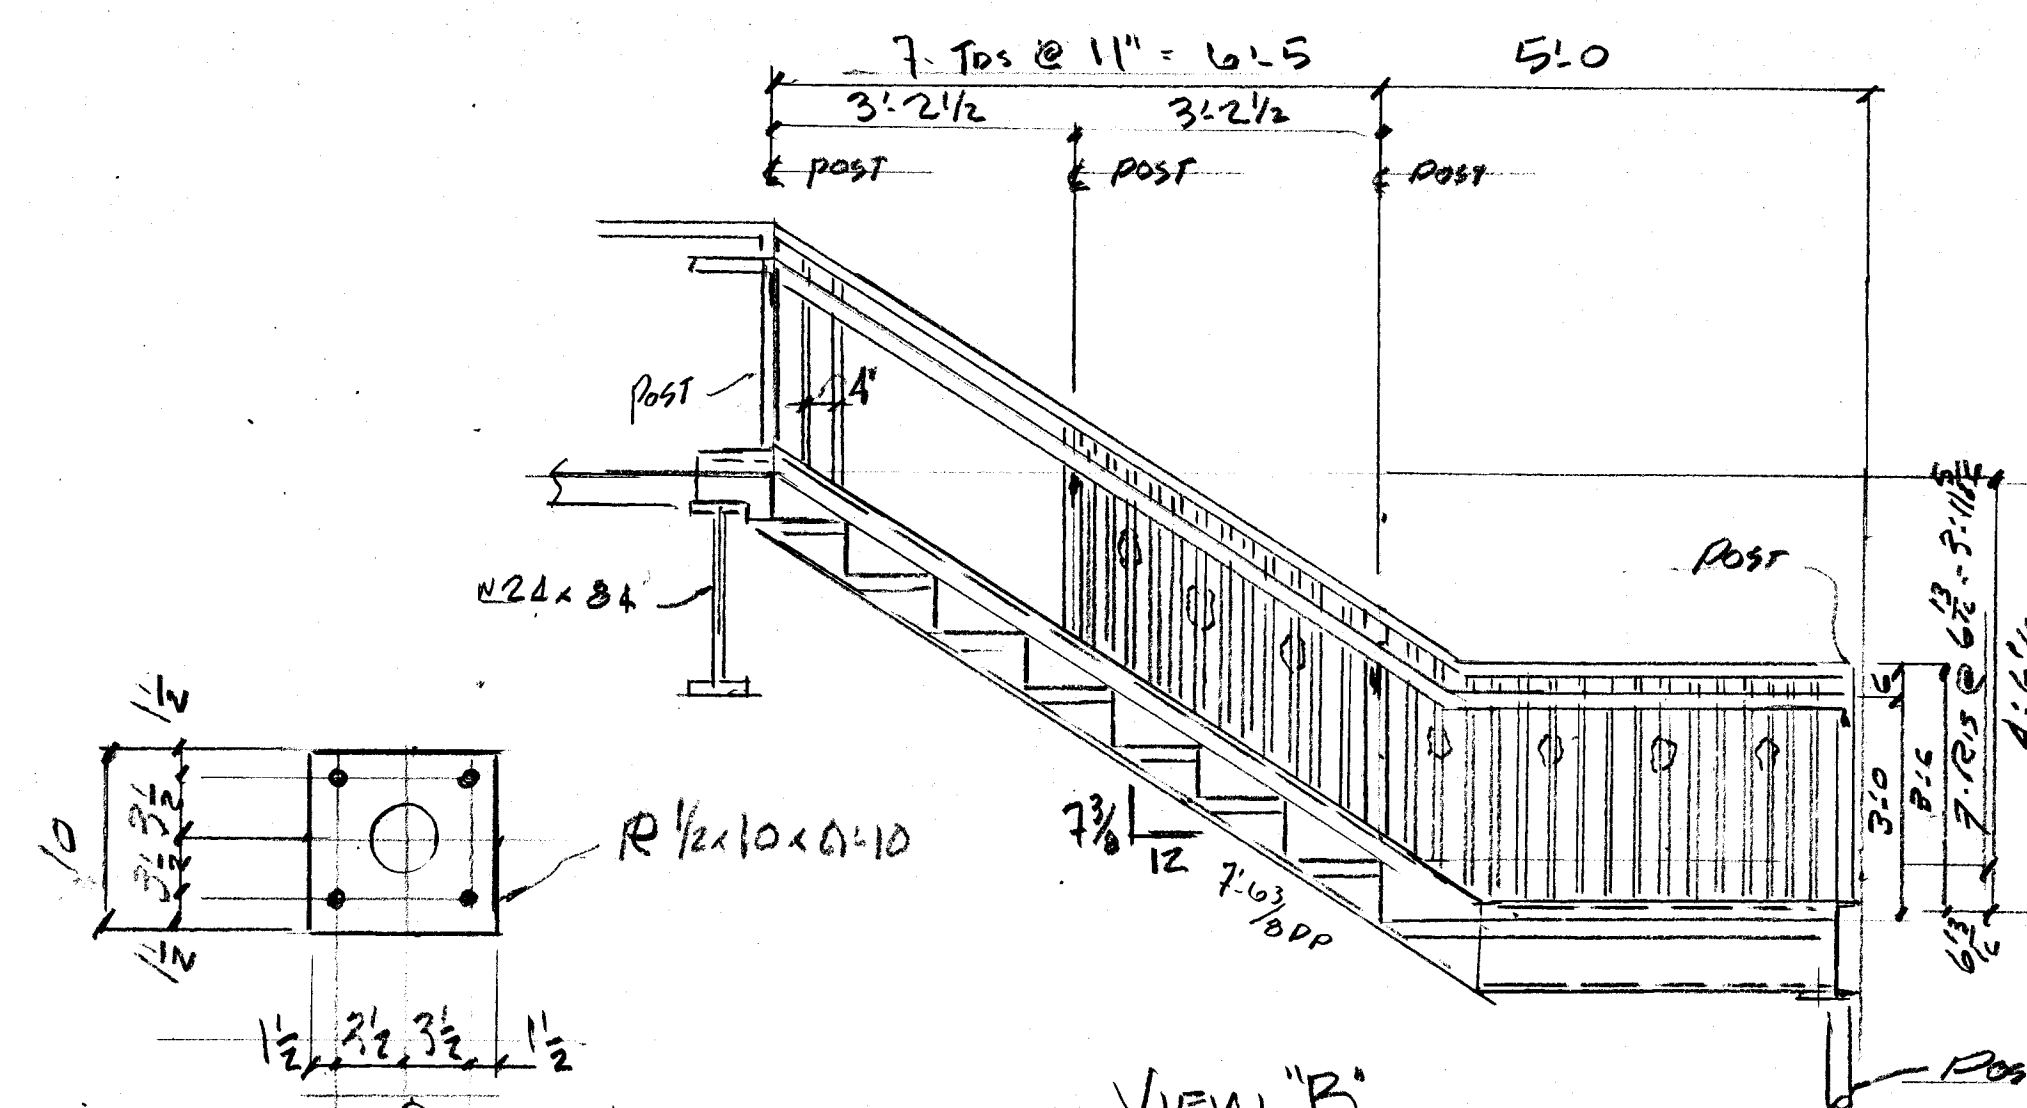


VIEW "B"

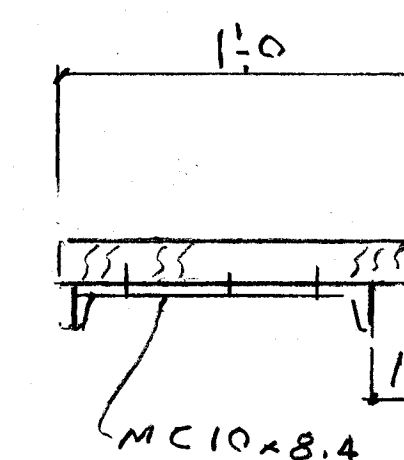

TREAD ATTACHMENT

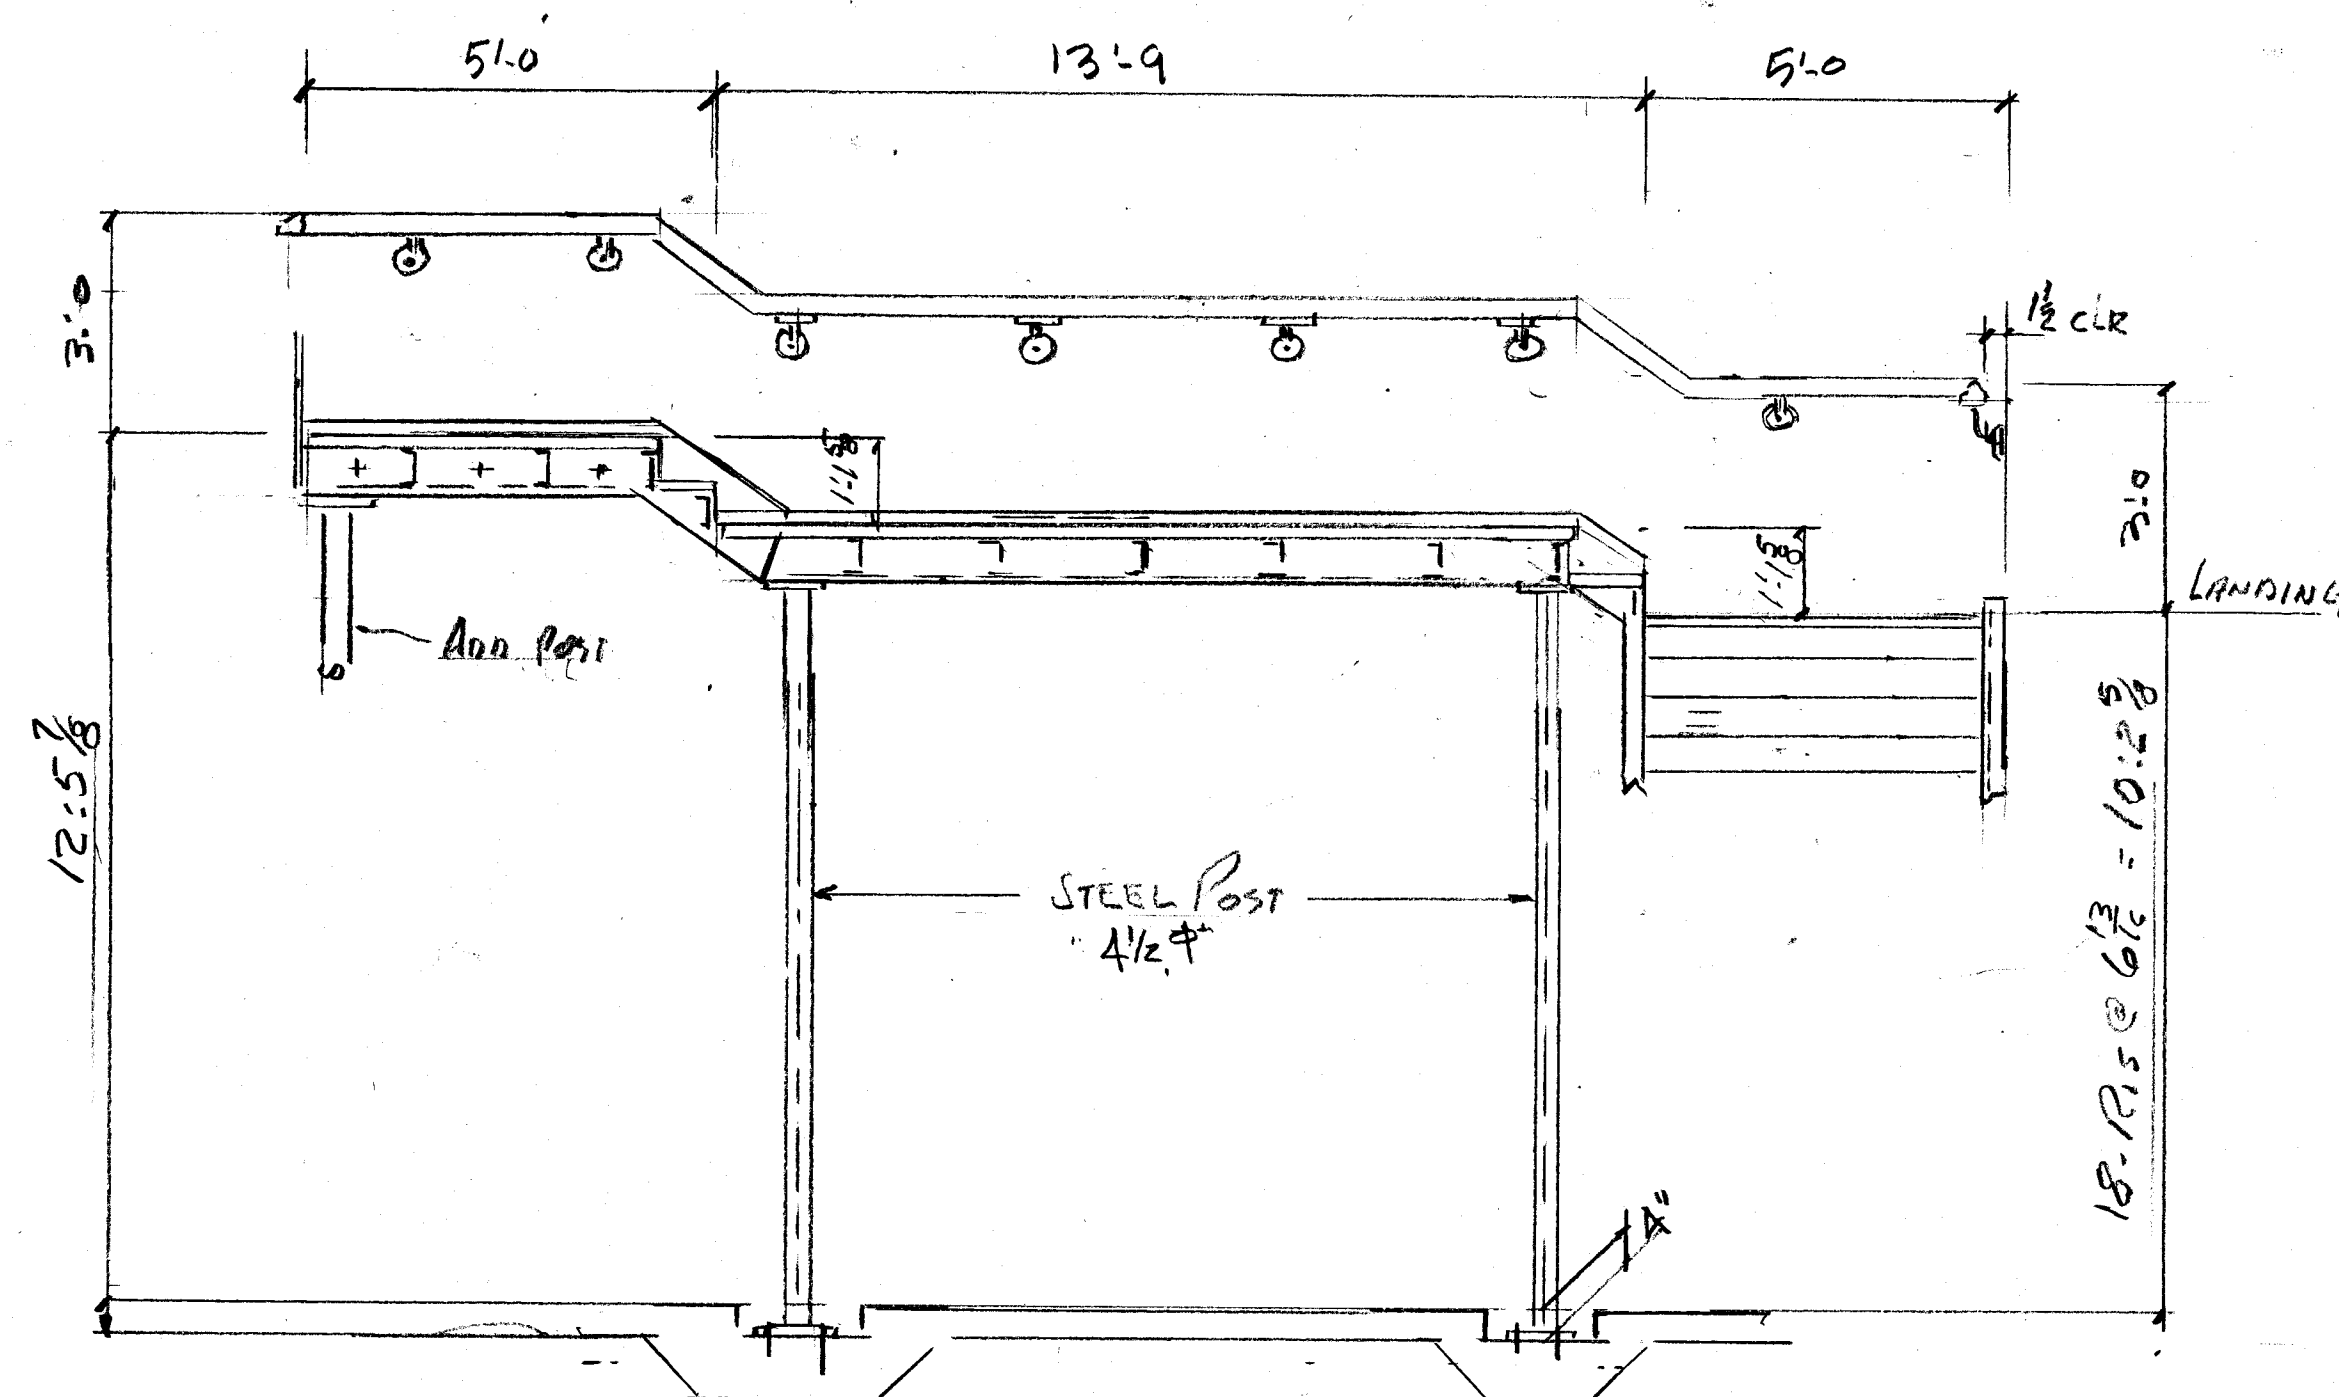


VIEW "D"

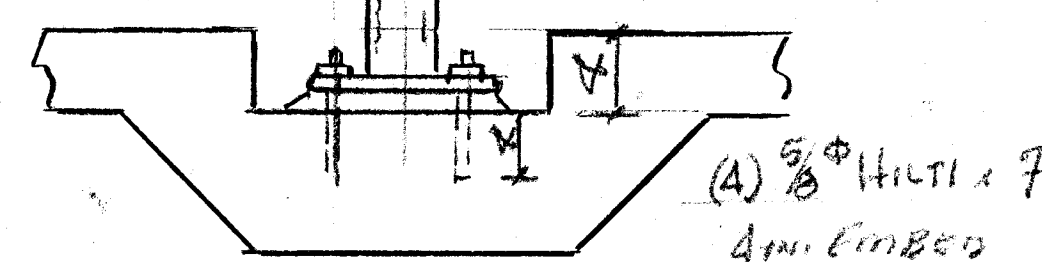

SECTION A'

THIS WILL NEED SOME SUPPORT

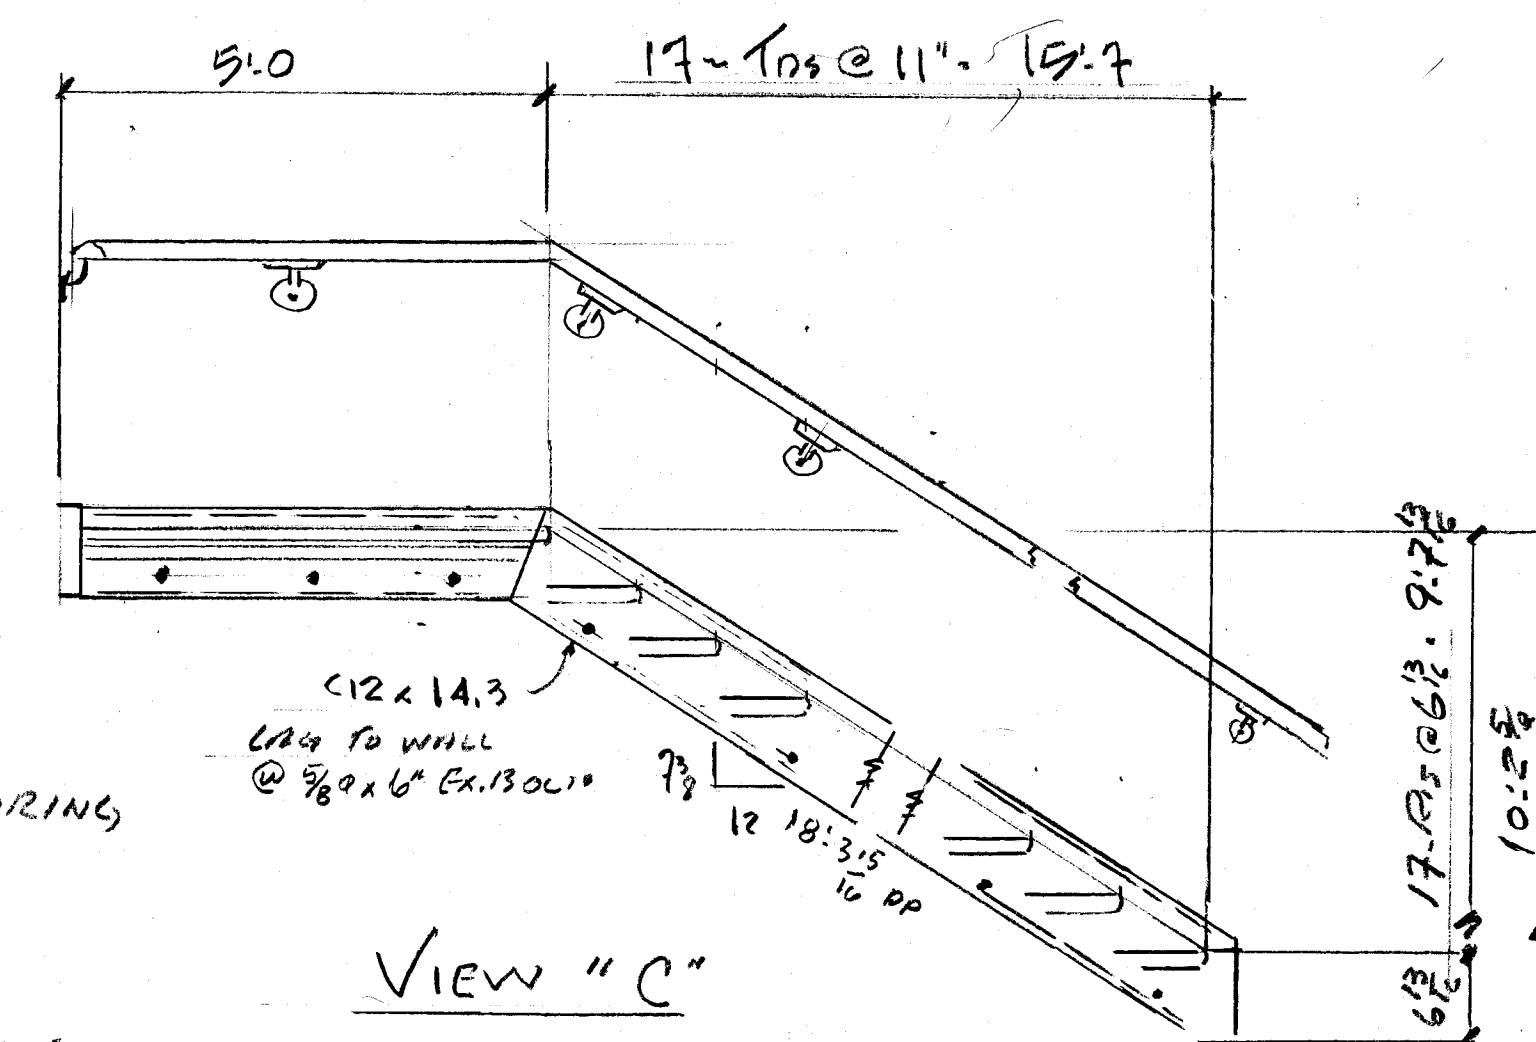


VIEW "C"

ERECTOR NOTE
KEEP BUILDING PLUMB AS ERECTION PROGRESSES. IF SHIMS ARE REQUIRED CONTACT NC STEEL SERVICES, INC. IMMEDIATELY.
FIELD CORRECTIONS DUE TO MISTAKE MUST BE AUTHORIZED WITHOUT EXCEPTION BY NC STEEL SERVICES, INC. OR BACK-CHARGE WILL NOT BE ACCEPTED.

REVISIONS			
NO.	DATE	BY	CHANCE
1	9-24-15	RI	Design
2			
3			
4			

NC STEEL SERVICES, INC. 252-393-7888	
JOB NAME	MOREHEAD CITY COUNTRY CLUB
LOCATION	MOREHEAD CITY, N.C.
DETAILS OF CONTRACTOR	MIDNIGHT
ARCHITECT	
DRAWN BY	JMM
CHECKED BY	
DATE	2-17-21
CONTRACT NO.	
SHEET	BD-6.4

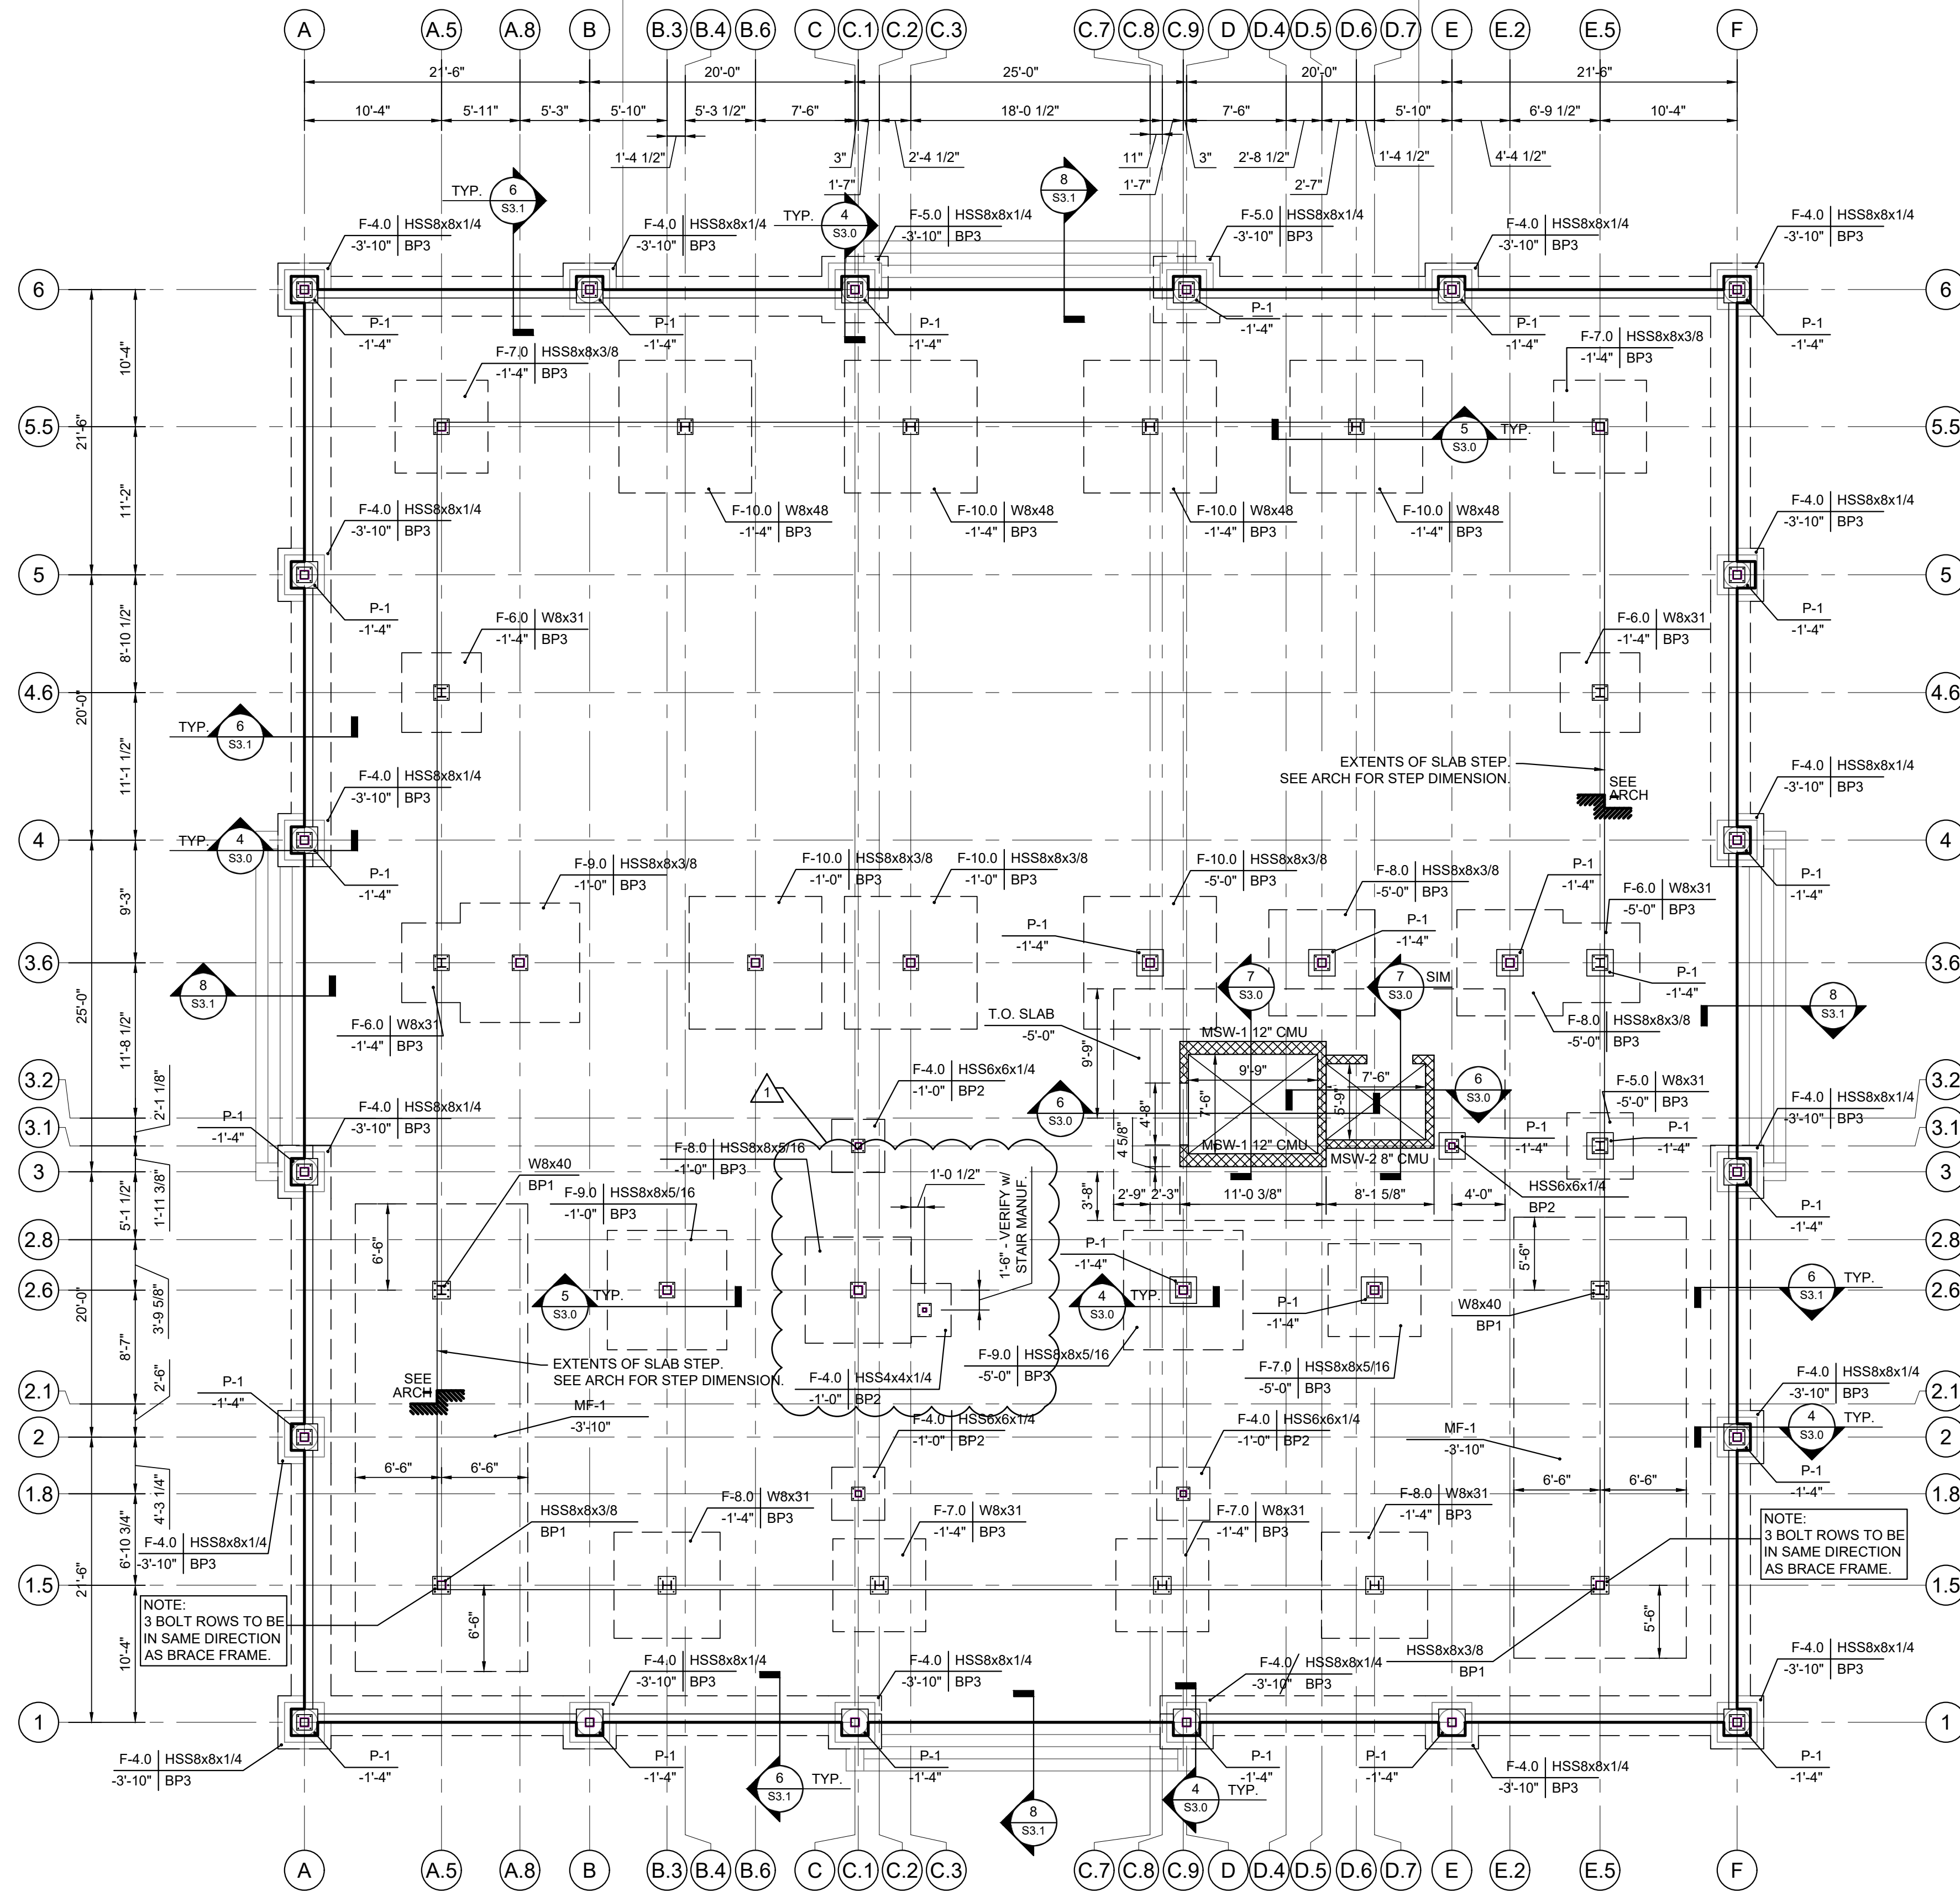


FOUNDATION PLAN

NOTES: SCALE: 1/8" = 1'-0"


- FOR GENERAL NOTES AND ABBREVIATIONS, SEE S0.1
- ELEVATIONS ON THE STRUCTURAL DRAWINGS REFER TO THE TOP OF CONCRETE REFERENCE ELEVATION SET AT 0'-0"
- FOR TYPICAL SLAB CONSTRUCTION DETAILS SEE SHEET S3.0
- FOR TYPICAL MASONRY WALL CONSTRUCTION DETAILS SEE SHEET S3.1
- VERIFY ALL DIMENSIONS & ELEVATIONS WITH ARCHITECTURAL DRAWINGS BEFORE CONSTRUCTION COMMENCES
- CENTERLINE OF FOOTING SHALL COINCIDE WITH THE FOUNDATION WALL AND COLUMN CENTERLINE UNLESS NOTED OTHERWISE
- BACKFILL & COMPACT BOTH SIDES OF FOUNDATION WALL SIMULTANEOUSLY
- FOR SIZE AND LOCATION OF ROOF, FLOOR, AND WALL OPENINGS SEE MECHANICAL AND ARCHITECTURAL DRAWINGS
- MSW-X DENOTES MASONRY SHEARWALLS ABOVE. SEE SHEET S3.1 FOR REINFORCEMENT LAYOUTS

MAT FOOTING SCHEDULE				
MARK	WIDTH	DEPTH	REINFORCING	
			LONGITUDINAL	TRANSVERSE
MF-1	SEE PLAN	36"	#7 @ 10" TOP & BOT	#7 @ 10" TOP & BOT
MF-2	SEE PLAN	42"	#7 @ 8" TOP & BOT	#7 @ 8" TOP & BOT

SPREAD FOOTING SCHEDULE		
MARK	SIZE	REINFORCING
F-4.0	4'-0"x4'-0"x18"	(5)#5 E.W. TOP & BOT
F-5.0	5'-0"x5'-0"x18"	(6)#5 E.W. BOT & BOT
F-6.0	6'-0"x6'-0"x18"	(10)#5 E.W. BOT
F-7.0	7'-0"x7'-0"x18"	(12)#5 E.W. BOT
F-8.0	8'-0"x8'-0"x18"	(13)#5 E.W. BOT
F-9.0	9'-0"x9'-0"x24"	(14)#6 E.W. BOT
F-10.0	10'-0"x10'-0"x24"	(16)#6 E.W. BOT

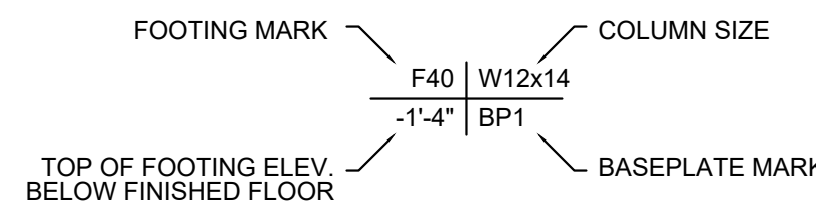


FIRST FLOOR LGS EXTERIOR WALL STUD SCHEDULE						
MARK	ZONE	STUD	BOTTOM TRACK	TOP TRACK	MAX. HEIGHT	BRACING
W1	4	600S250-54 @ 16" O.C.	600T125-54	600T125-54	15'-4"	CRC w/ BC600 @ 5'-0" O.C. MAX.
	5	600S250-54 @ 12" O.C.	600T125-54	600T125-54	15'-4"	CRC w/ BC600 @ 5'-0" O.C. MAX.
W2	4	800S250-54 @ 16" O.C.	800T125-54	800T125-54	15'-4"	CRC w/ BC800 @ 5'-0" O.C. MAX.
	5	800S250-54 @ 12" O.C.	800T125-54	800T125-54	15'-4"	CRC w/ BC800 @ 5'-0" O.C. MAX.

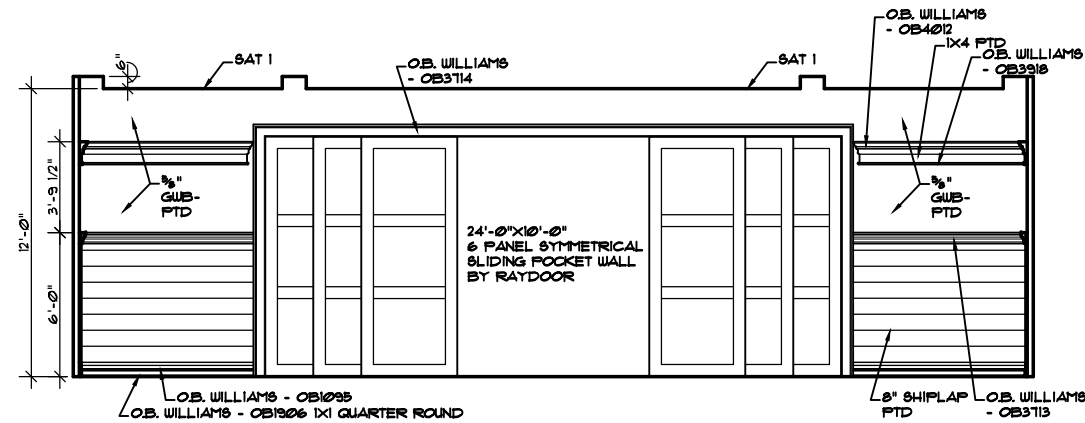

MEMBER DINING POCKET WALL ELEVATION

3
BD-9


SCALE: 1/8" = 1'-0"

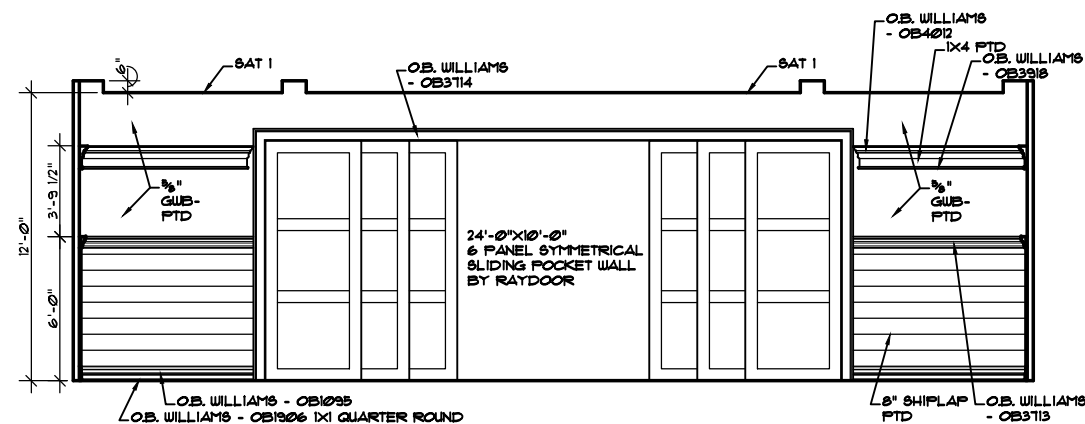

MEMBER DINING POCKET WALL ELEVATION

2
BD-9

SCALE: 1/8" = 1'-0"

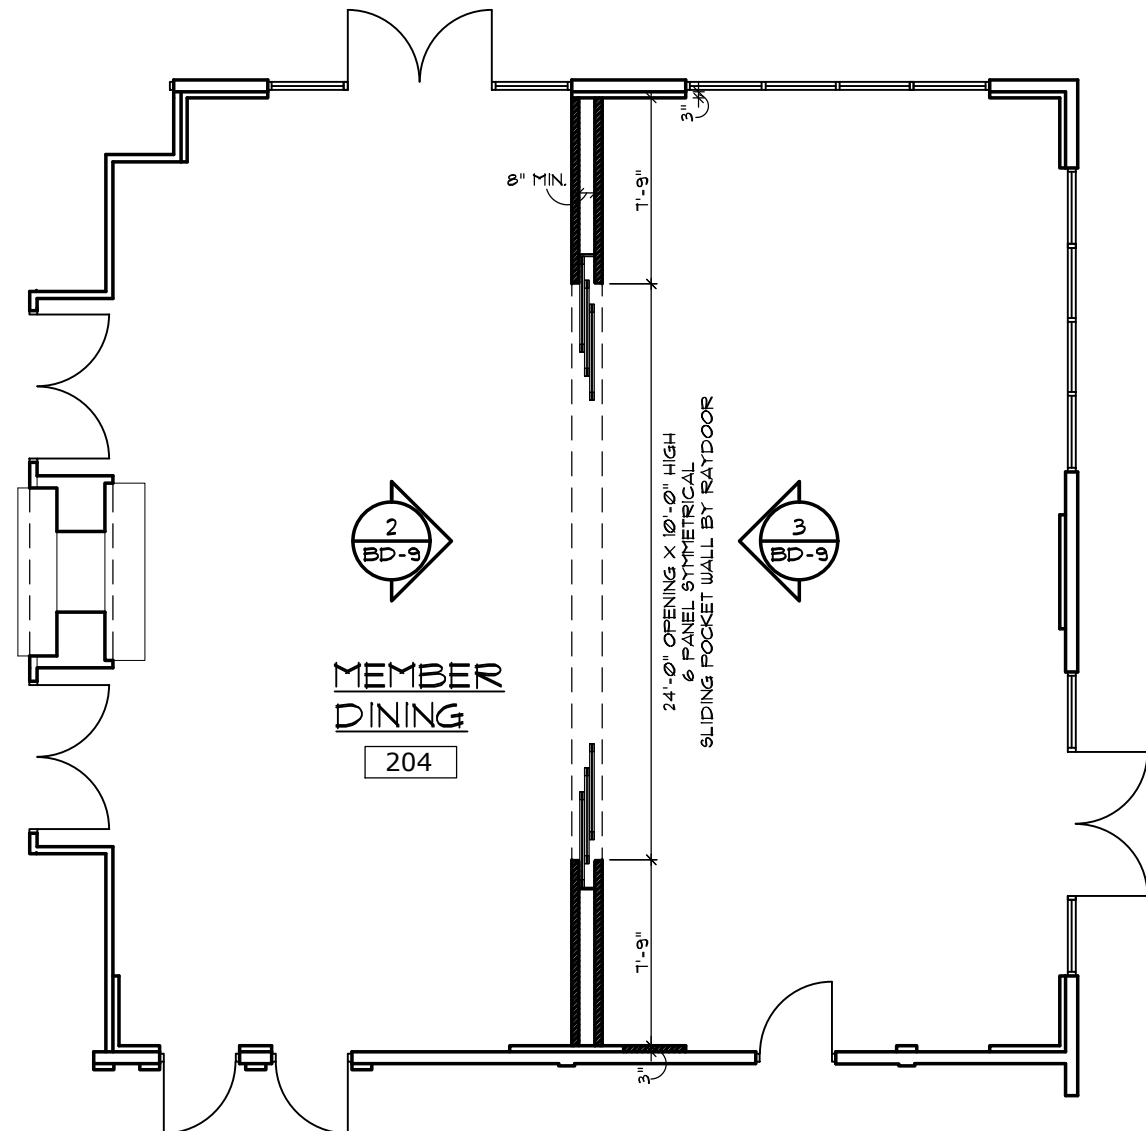


MEMBER DINING POCKET WALL

1
BD-9

SCALE: 1/8" = 1'-0"

NOTE: HVAC REGISTERS AND LIGHTS
RELOCATED TO ACCOMMODATE NEW
POCKET DOOR WALL

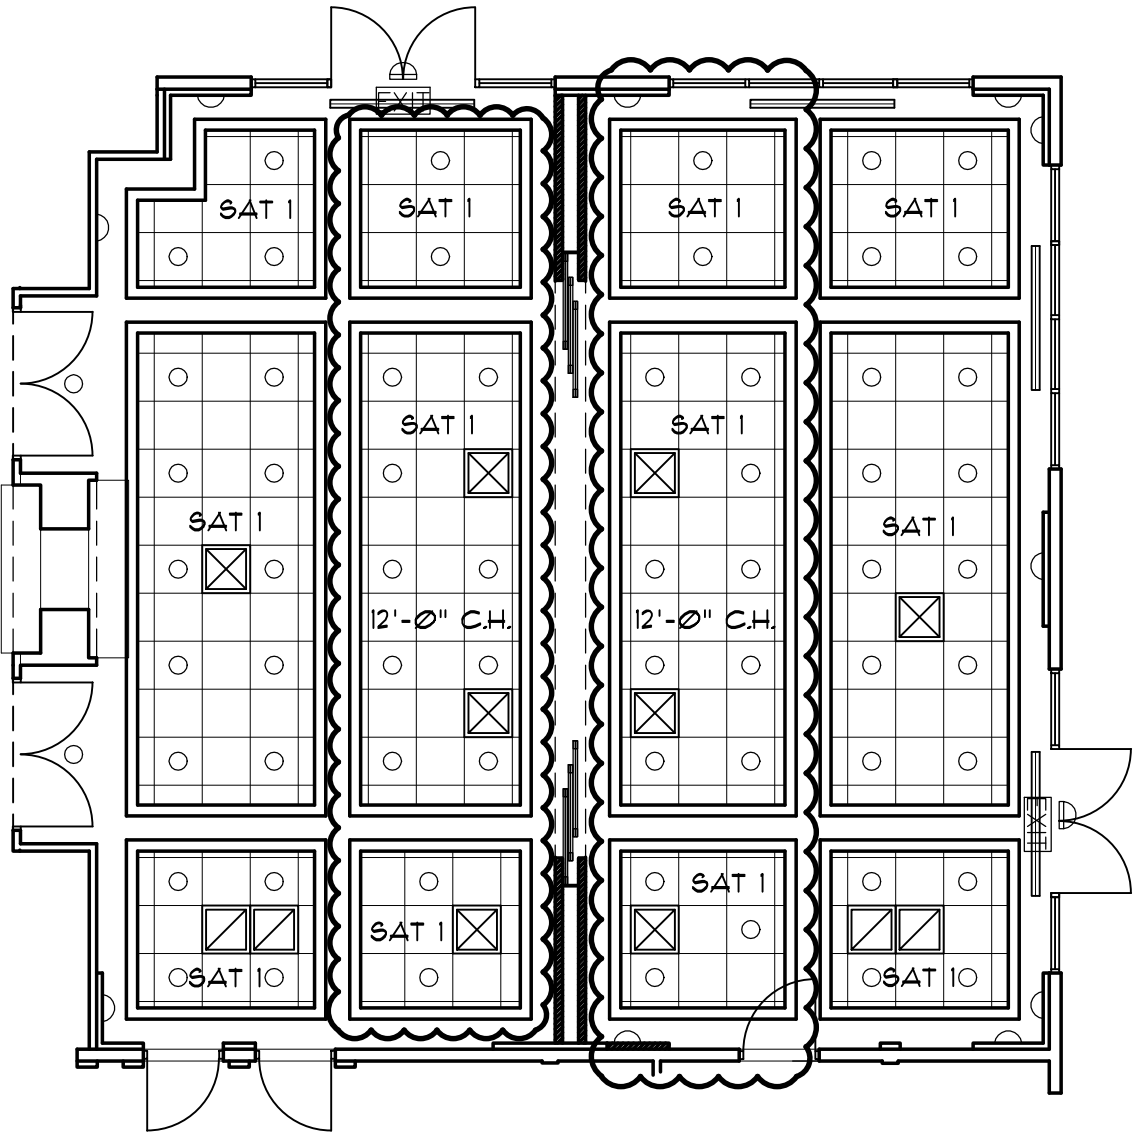

MEMBER DINING
POCKET WALL RCP



SCALE: 1/8" = 1' - 0"